



BSI Standards Publication

Plastics piping systems for non-pressure underground drainage and sewerage - Polypropylene (PP)

Part 1: Specifications for pipes, fittings and the system

National foreword

This British Standard is the UK implementation of EN 1852-1:2018. It supersedes BS EN 1852-1:2009, which is withdrawn.

The UK participation in its preparation was entrusted to Technical Committee PRI/88/1, Plastics piping for non-pressure applications.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2018
Published by BSI Standards Limited 2018

ISBN 978 0 580 93159 8

ICS 93.030

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 January 2018.

Amendments/corrigenda issued since publication

| Date | Text affected |
|------|---------------|
|------|---------------|

EUROPEAN STANDARD

EN 1852-1

NORME EUROPÉENNE

EUROPÄISCHE NORM

January 2018

ICS 93.030

Supersedes EN 1852-1:2009

English Version

Plastics piping systems for non-pressure underground drainage and sewerage - Polypropylene (PP) - Part 1: Specifications for pipes, fittings and the system

Systèmes de canalisations en plastique pour les branchements et les collecteurs d'assainissement enterrés sans pression - Polypropylène (PP) - Partie 1: Spécifications pour tubes, raccords et le système

Kunststoff-Rohrleitungssysteme für erdverlegte drucklose Abwasserkanäle und -leitungen - Polypropylen (PP) - Teil 1: Anforderungen an Rohre, Formstücke und das Rohrleitungssystem

This European Standard was approved by CEN on 20 November 2017.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Contents

Page

| | |
|---|-----------|
| European foreword..... | 4 |
| 1 Scope | 6 |
| 2 Normative references | 6 |
| 3 Terms and definitions | 8 |
| 4 Symbols and abbreviations | 10 |
| 4.1 Symbols | 10 |
| 4.2 Abbreviations | 11 |
| 5 Material | 11 |
| 5.1 PP final compound | 11 |
| 5.2 Utilization of non-virgin material | 11 |
| 5.3 Melt mass-flow rate | 11 |
| 5.4 Resistance to internal pressure | 12 |
| 5.5 Thermal stability (OIT) | 12 |
| 5.6 Sealing ring retaining means | 12 |
| 6 General characteristics | 13 |
| 6.1 Appearance | 13 |
| 6.2 Colour | 13 |
| 7 Geometrical characteristics | 13 |
| 7.1 General | 13 |
| 7.2 Dimensions of pipes | 13 |
| 7.2.1 Outside diameters | 13 |
| 7.2.2 Outside diameters with close tolerances (CT) | 14 |
| 7.2.3 Length of pipes | 15 |
| 7.2.4 Chamfering | 16 |
| 7.2.5 Wall thicknesses | 16 |
| 7.3 Dimensions of fittings | 17 |
| 7.3.1 Outside diameters | 17 |
| 7.3.2 Design lengths | 17 |
| 7.3.3 Wall thicknesses | 18 |
| 7.4 Dimensions of sockets and spigots | 19 |
| 7.4.1 Diameters and lengths of elastomeric ring seal sockets and spigots | 19 |
| 7.4.2 Wall thicknesses of sockets | 22 |
| 7.5 Types of fittings | 23 |
| 8 Mechanical characteristics | 26 |
| 8.1 Mechanical characteristics of pipes | 26 |
| 8.1.1 General requirements | 26 |
| 8.1.2 Additional mechanical requirements | 27 |
| 8.2 Mechanical characteristics of fittings | 28 |
| 9 Physical characteristics | 29 |
| 9.1 Physical characteristics of pipes | 29 |
| 9.2 Physical characteristics of fittings | 30 |
| 10 Performance requirements | 31 |

| | | |
|--------------|---|-----------|
| 11 | Sealing rings | 31 |
| 12 | Marking | 32 |
| 12.1 | General | 32 |
| 12.2 | Minimum required marking of pipes | 32 |
| 12.3 | Minimum required marking of fittings..... | 33 |
| 12.4 | Additional marking..... | 34 |
| | Annex A (normative) Utilization of non-virgin PP material..... | 35 |
| A.1 | Own reprocessed material from pipes and fittings..... | 35 |
| A.2 | External reprocessed and recycled materials with an agreed specification | 35 |
| A.2.1 | Material from PP pipes and fittings | 35 |
| A.2.2 | Material from PP products other than pipes and fittings | 36 |
| | Annex B (informative) General characteristics of PP pipes and fittings | 37 |
| B.1 | General | 37 |
| B.2 | Material characteristics | 37 |
| B.3 | Ring stiffness | 37 |
| B.4 | Chemical resistance | 38 |
| B.5 | Abrasion resistance | 38 |
| B.6 | Hydraulic roughness | 38 |
| B.7 | Diametric deflection | 38 |
| | Annex C (informative) Product standards of components that can be connected to components conforming to this standard..... | 39 |
| | Bibliography | 40 |

European foreword

This document (EN 1852-1:2018) has been prepared by Technical Committee CEN/TC 155 "Plastics piping systems and ducting systems", the secretariat of which is held by NEN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by July 2018, and conflicting national standards shall be withdrawn at the latest by July 2018.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN not be held responsible for identifying any or all such patent rights.

This document supersedes EN 1852-1:2009.

In this revised document, the following changes have been made:

- updating in accordance with the new template;
- updating of normative references;
- clause 5.1 has got a new title "PP final compound" and an additional requirement for the maximum allowed content of minerals have been introduced ;
- thermal stability (OIT) requirement is made valid in general;
- two new dimensions have been introduced in Tables 2 to 6 – 560 mm and 710 mm;
- three new dimensions have been introduced in Table 3;
- Annex A for pipes S-series 11,2 has been deleted;
- a new Annex A for utilization of non-virgin PP material has been added.

The System Standards are based on the results of the work undertaken in ISO/TC 138 "Plastics pipes, fittings and valves for the transport of fluids", which is a Technical Committee of the International Organization for Standardization (ISO).

The System Standards are supported by separate standards on test methods to which references are made throughout the System Standard.

The System Standards are consistent with general standards on functional requirements and on recommended practice for installation.

EN 1852 consists of the following parts, under the general title *Plastics piping systems for non-pressure underground drainage and sewerage – Polypropylene (PP)*:

- *Part 1: Specifications for pipes, fittings and the system* (the present standard)
- *Part 2: Guidance for the assessment of conformity* (CEN Technical Specification)

This part of EN 1852 includes Annex A (normative) "Utilization of non-virgin PP materials", Annex B (informative), "General characteristics of PP pipes and fittings" and Annex C (informative), "Product standards of components that can be connected to components conforming to this standard".

Plastics piping systems made of PP with mineral modifiers (PP-MD) are covered by EN 14758-1 [1].

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

1 Scope

This part of EN 1852 specifies the requirements for solid wall pipes with smooth internal and external surfaces extruded from the same compound/formulation throughout the wall, fittings and the system of polypropylene (PP) piping systems intended for use for:

- non-pressure underground drainage and sewerage outside the building structure (application area code "U"), and
- non-pressure underground drainage and sewerage for both buried in ground within the building structure (application area code "D") and outside the building structure.

This is reflected in the marking of products by "U" and "UD".

This standard covers PP materials without mineral modifiers.

It also specifies the test parameters for the test methods referred to in this standard.

NOTE 1 Solid wall multilayer pipes with different formulation throughout the wall and foamed core pipes are covered by EN 13476-2 [1] (see also CEN ISO/TR 27165 [2]).

This standard covers a range of nominal sizes, and pipe series and gives recommendations concerning colours.

NOTE 2 It is the responsibility of the purchaser or specifier to make the appropriate selection from these aspects, taking into account their particular requirements and any relevant national regulations and installation practices or codes.

In conjunction with CEN/TS 1852-2, it is applicable to PP pipes and fittings, their joints and to joints with components of other plastics and non-plastics materials intended to be used for buried piping systems for non-pressure underground drainage and sewerage.

The fittings can be manufactured by injection-moulding or be fabricated from pipes and/or mouldings.

NOTE 3 Pipes, fittings and other components conforming to any of the plastics product standards listed in Annex C can be connected to pipes and fittings conforming to this standard, when they conform to the requirements for joint dimensions given in Clause 6 and to the requirements of Table 14.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 681-1, *Elastomeric seals — Materials requirements for pipe joint seals used in water and drainage applications — Part 1: Vulcanized rubber*

EN 681-2, *Elastomeric Seals — Materials requirements for pipe joint seals used in water and drainage applications — Part 2: Thermoplastic elastomers*

EN 12099, *Plastics piping systems — Polyethylene piping materials and components — Determination of volatile content*

EN ISO 472, *Plastics — Vocabulary (ISO 472)*

EN ISO 580, *Plastics piping and ducting systems — Injection-moulded thermoplastics fittings — Methods for visually assessing the effects of heating (ISO 580)*

EN ISO 1043-1, *Plastics — Symbols and abbreviated terms — Part 1: Basic polymers and their special characteristics (ISO 1043-1)*

EN ISO 1133-1, *Plastics — Determination of the melt mass-flow rate (MFR) and melt volume-flow rate (MVR) of thermoplastics — Part 1: Standard method (ISO 1133-1)*

EN ISO 1167-1, *Thermoplastics pipes, fittings and assemblies for the conveyance of fluids — Determination of the resistance to internal pressure — Part 1: General method (ISO 1167-1)*

EN ISO 1167-2, *Thermoplastics pipes, fittings and assemblies for the conveyance of fluids — Determination of the resistance to internal pressure — Part 2: Preparation of pipe test pieces (ISO 1167-2)*

EN ISO 1183-2, *Plastics — Methods for determining the density of non-cellular plastics — Part 2: Density gradient column method (ISO 1183-2)*

EN ISO 2505, *Thermoplastics pipes — Longitudinal reversion — Test method and parameters (ISO 2505)*

EN ISO 3126, *Plastics piping systems — Plastics components — Determination of dimensions (ISO 3126)*

EN ISO 3451-1, *Plastics — Determination of ash — Part 1: General methods (ISO 3451-1)*

EN ISO 9969:2016, *Thermoplastics pipes — Determination of ring stiffness (ISO 9969:2016)*

EN ISO 11357-6, *Plastics — Differential scanning calorimetry (DSC) — Part 6: Determination of oxidation induction time (isothermal OIT) and oxidation induction temperature (dynamic OIT) (ISO 11357-6)*

EN ISO 3127, *Thermoplastics pipes — Determination of resistance to external blows — Round-the-clock method (ISO 3127)*

EN ISO 11173, *Thermoplastics pipes — Determination of resistance to external blows — Staircase method (ISO 11173)*

EN ISO 13254, *Thermoplastics piping systems for non-pressure applications — Test method for watertightness (ISO 13254)*

EN ISO 13257:2017, *Thermoplastics piping systems for non-pressure applications — Test method for resistance to elevated temperature cycling (ISO 13257:2010)*

prEN ISO 13259, *Thermoplastics piping systems for underground non-pressure applications — Test method for leaktightness of elastomeric sealing ring type joints (ISO/DIS 13259)*

EN ISO 13263, *Thermoplastics piping systems for non-pressure underground drainage and sewerage — Thermoplastics fittings — Test method for impact strength (ISO 13263)*

EN ISO 13264, *Thermoplastics piping systems for non-pressure underground drainage and sewerage — Thermoplastics fittings — Test method for mechanical strength or flexibility of fabricated fittings (ISO 13264)*

ISO 4065:1996, *Thermoplastics pipes — Universal wall thickness table*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN-ISO 472, EN-ISO 1043-1 and the following apply.

3.1 application area code

code used in the marking of pipes and fittings to indicate the application area for which they are intended, as follows:

U: application area code for the area more than 1 m from the building to which the buried piping system is connected;

D: application area code for the area under and within 1 m from the building where the pipes and the fittings are buried in ground and are connected to the soil and waste discharge system of the building

Note 1 to entry: In code D application areas, the existence of hot water discharge in addition to the external forces from the surroundings is usual.

3.2 nominal size DN/OD

numerical designation of the size of a component, which is a convenient round number approximately equal to the manufacturing dimension of the outside diameter, in millimetres

3.3 nominal outside diameter

d_n
specified outside diameter, in millimetres, assigned to a nominal size DN/OD

3.4 outside diameter

d_e
value of the measurement of the outside diameter through its cross section at any point of a pipe or spigot end of a fitting, rounded up to the next greater 0,1 mm

3.5 mean outside diameter

d_{em}
value of the measurement of the outer circumference of a pipe or spigot end of a fitting in any cross section, divided by π ($\approx 3,142$), rounded to the next greater 0,1 mm

3.6 mean inside diameter of a socket

d_{sm}
arithmetical mean of a number of measurements of the inside diameter of a socket in the same cross section

3.7 wall thickness

e
value of the measurement of the wall thickness at any point around the circumference of a component

3.8
mean wall thickness

e_m

arithmetical mean of a number of measurements of the wall thickness, regularly spaced around the circumference and in the same cross section of a component, including the measured minimum and the measured maximum values of the wall thickness in that cross section

3.9
pipes series

S

number for pipe designation (see ISO 4065:1996, 3.6)

3.10
standard dimension ratio

SDR

numerical designation of a pipe series, which is a convenient round number approximately equal to the ratio of the nominal outside diameter, d_n , and the minimum wall thickness, e_{min}

3.11
nominal ring stiffness

SN

numerical designation of the ring stiffness of a pipe or fitting, which is a convenient round number, relative to the determined stiffness in kilonewtons per square metre (kN/m^2), indicating the minimum ring stiffness of a pipe or fitting

3.12
solid wall pipe

pipe with smooth internal and external surface with same compound/formulation throughout the wall

3.13
virgin material

material in a form such as granules or powder that has not been subjected to use or processing other than that required for its manufacture and to which no reprocessed or recycled material has been added

3.14
own reprocessed material

material prepared from rejected unused pipes or fittings, including trimmings from the production of pipes or fittings, that will be reprocessed in a manufacturer's plant after having been previously processed by the same manufacturer by a process such as moulding or extrusion, and for which the complete formulation is known

3.15
external reprocessed material

material comprising either one of the following forms:

- a) material from rejected unused pipes or fittings or trimmings there from, that will be reprocessed and that were originally processed by another manufacturer;
- b) material from the production of unused PP products other than pipes and fittings, regardless of where they are manufactured

3.16

recycled material

material comprising either one of the following forms:

- a) material from used pipes or fittings which have been cleaned and crushed or ground;
- b) material from used PP products other than pipes or fittings which have been cleaned and crushed or ground

3.17

mineral modified material (PP-MD)

material to which has been added minerals during specific processing operation(s) which during such processing is well distributed in the material

4 Symbols and abbreviations

4.1 Symbols

| | |
|----------|--|
| A | length of engagement |
| C | depth of sealing zone |
| d_e | outside diameter |
| d_{em} | mean outside diameter |
| d_n | nominal outside diameter |
| d_{sm} | mean inside diameter of a socket |
| e | wall thickness |
| e_m | mean wall thickness |
| e_2 | wall thickness of a socket |
| e_3 | wall thickness in the groove area |
| l | effective length of a pipe |
| L_1 | length of spigot |
| M | length of spigot of a plug |
| R | radius of swept fittings |
| Z | design length of (a part of) a fitting |
| α | nominal angle of a fitting |

4.2 Abbreviations

| | |
|-------|--|
| CT | close tolerance |
| DN | nominal size |
| DN/OD | nominal size, outside diameter related |
| MFR | melt mass-flow rate |
| OIT | oxidation induction time |
| PP | polypropylene |
| S | pipes series |
| SDR | standard dimension ratio |
| SN | nominal ring stiffness |
| TIR | true impact rate |

5 Material

5.1 PP final compound

The final compound for pipes and fittings shall be PP base material without added mineral modifiers, to which is added those additives that are needed to facilitate the manufacture of components, and with added non-virgin material (if applicable) conforming to the requirements of this standard.

NOTE PP-based materials with added mineral modifiers (PP-MD) are covered in EN 14758-1 [3].

Due to the use of additives and non-virgin material, which both can contain minerals, the maximum content of minerals in the final compound shall be $\leq 3,0$ % by mass.

The content of the minerals (Ash residue) shall be tested in accordance with EN ISO 3451-1.

5.2 Utilization of non-virgin material

For the utilization of non-virgin PP materials, conditions and requirements are given in Annex A.

5.3 Melt mass-flow rate

Pipes and fittings shall be made from materials with an MFR as follows:

$MFR(230/2,16) \leq 1,5$ g/10 min.

The MFR of the base material shall be tested in accordance with EN ISO 1133-1, using the test parameters: temperature 230 °C and loading mass 2,16 kg.

Materials for pipes and fittings for butt fusion joints shall be designated by the following classes with regard to the MFR:

Class A: $MFR \leq 0,3$ g/10 min;

Class B: $0,3$ g/10 min < $MFR \leq 0,6$ g/10 min;

Class C: $0,6$ g/10 min < $MFR \leq 0,9$ g/10 min;

Class D: $0,9$ g/10 min < $MFR \leq 1,5$ g/10 min.

Only pipes and fittings made from materials of the same or an adjacent MFR class may be fused together.

5.4 Resistance to internal pressure

When tested in accordance with the test method as specified in Table 1, using the indicated parameters, the material shall have characteristics conforming to the requirements given in Table 1.

The material shall be tested in the form of a pipe.

Table 1 — Material characteristics (long-term behaviour)

| Characteristic | Requirements | Test parameters | | Test method |
|---------------------------------|-----------------------------------|-------------------------------|------------------|--------------------------------|
| Resistance to internal pressure | No failure during the test period | End caps | Type A or type B | EN ISO 1167-1 EN ISO 1167-2 |
| | | Test temperature | 80 °C | |
| | | Orientation | free | |
| | | Number of test pieces | 3 | |
| | | Circumferential (hoop) stress | 4,2 MPa | |
| | | Conditioning period | 1 h | |
| | | Type of test | Water-in-water | |
| | | Test period | 140 h | |
| | | End caps | Types A or B | |
| | | Test temperature | 95 °C | |
| | | Orientation | free | |
| | | Number of test pieces | 3 | |
| | | Circumferential (hoop) stress | 2,5 MPa | |
| | | Conditioning period | 1 h | |
| Type of test | Water-in-water | | | |
| Test period | 1 000 h | | | |

5.5 Thermal stability (OIT)

The test shall be carried out in accordance with EN ISO 11357-6 using a test temperature of 200 °C. The oxidation induction time of the material shall not be less than 8 min.

5.6 Sealing ring retaining means

Sealing rings may be retained using means made from polymers other than PP.

6 General characteristics

6.1 Appearance

When viewed without magnification, the following requirements apply.

The internal and external surfaces of pipes and fittings shall be smooth, clean and free from grooving, blistering, impurities and pores and any other surface irregularity likely to prevent their conformity to this standard.

Pipe ends shall be cleanly cut and the ends of pipes and fittings shall be square to their axis.

6.2 Colour

The pipes and fittings shall be coloured through the wall.

The colour should preferably be black, orange-brown (approximately RAL 8023¹) or dusty grey (approximately RAL 7037¹). Other colours may be used.

7 Geometrical characteristics

7.1 General

Dimensions shall be measured in accordance with EN ISO 3126.

NOTE The figures are schematic sketches only, to indicate the relevant dimensions. They do not necessarily represent the manufactured components.

7.2 Dimensions of pipes

7.2.1 Outside diameters

The mean outside diameter, d_{em} , shall conform to Table 2 or Table 3, as applicable.

1) See colour register RAL 840-HR [4].

Table 2 — Mean outside diameters

Dimensions in millimetres

| Nominal size DN/OD | Nominal outside diameter d_n | Mean outside diameter ^a | |
|-----------------------|--------------------------------------|------------------------------------|--------------|
| | | $d_{em,min}$ | $d_{em,max}$ |
| 110 | 110 | 110,0 | 110,4 |
| 125 | 125 | 125,0 | 125,4 |
| 160 | 160 | 160,0 | 160,5 |
| 200 | 200 | 200,0 | 200,6 |
| 250 | 250 | 250,0 | 250,8 |
| 315 | 315 | 315,0 | 316,0 |
| 355 | 355 | 355,0 | 358,2 |
| 400 | 400 | 400,0 | 403,6 |
| 450 | 450 | 450,0 | 454,1 |
| 500 | 500 | 500,0 | 504,5 |
| 560 | 560 | 560,0 | 565,0 |
| 630 | 630 | 630,0 | 635,7 |
| 710 | 710 | 710,0 | 716,4 |
| 800 | 800 | 800,0 | 807,2 |
| 1 000 | 1 000 | 1 000,0 | 1 009,0 |
| 1 200 | 1 200 | 1 200,0 | 1 210,0 |
| 1 400 | 1 400 | 1 400,0 | 1 410,0 |
| 1 600 | 1 600 | 1 600,0 | 1 610,0 |

^a The tolerances for mean outside diameters up to and including 315 mm conform to ISO 11922-1:1997 [5], grade C.
The tolerances for mean outside diameters greater than 315 mm conform to ISO 11922-1:1997 [5], grade A.

7.2.2 Outside diameters with close tolerances (CT)

For the purposes of this standard in addition to the dimensions and tolerances given in Table 2 for spigot ends of pipes and fittings, tolerances which are in accordance with EN 1401-1 [6] may be used.

If these tolerances, classified as close tolerance (CT), are required, the mean outside diameter, d_{em} , and the tolerances shall conform to Table 3.

Table 3 — Mean outside diameters with close tolerances type CT

Dimensions in millimetres

| Nominal size DN/OD | Nominal outside diameter | Mean outside diameter | |
|-----------------------|-----------------------------|-----------------------|--------------|
| | d_n | $d_{em,min}$ | $d_{em,max}$ |
| 200 | 200 | 200,0 | 200,5 |
| 250 | 250 | 250,0 | 250,5 |
| 315 | 315 | 315,0 | 315,6 |
| 355 | 355 | 355,0 | 355,7 |
| 400 | 400 | 400,0 | 400,7 |
| 450 | 450 | 450,0 | 450,8 |
| 500 | 500 | 500,0 | 500,9 |
| 560 | 560 | 560,0 | 561,0 |
| 630 | 630 | 630,0 | 631,1 |
| 710 | 710 | 710,0 | 711,2 |
| 800 | 800 | 800,0 | 801,3 |
| 1000 | 1000 | 1 000,0 | 1 001,6 |

NOTE Spigot ends of pipes and fittings with maximum mean outside diameters conforming to Table 3 can be used with pipes and fittings conforming to EN 1401-1 [6] provided that the socket(s) for these pipes and fittings are intended to be used for elastomeric ring seal joints.

7.2.3 Length of pipes

The effective length of a pipe, l , shall be not less than that declared by the manufacturer when measured as shown in Figure 1.

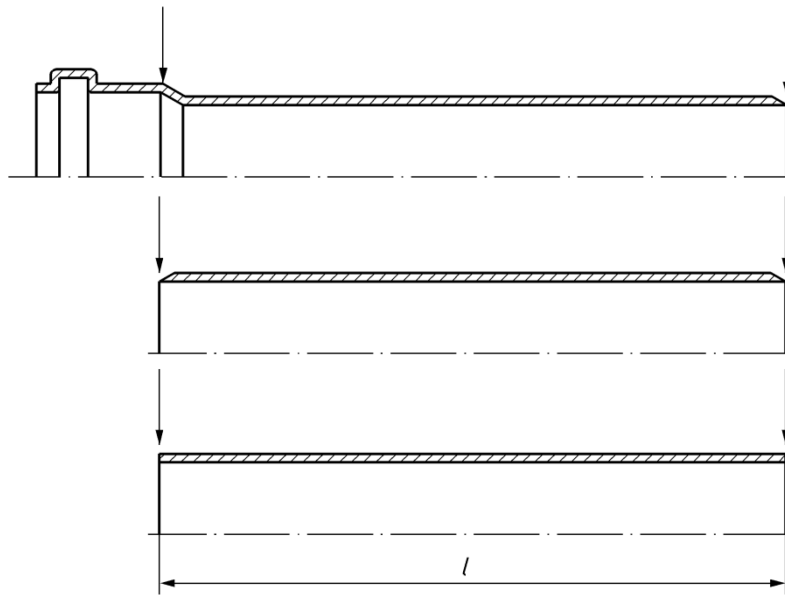


Figure 1 — Effective length of pipes

7.2.4 Chamfering

If a chamfer is applied, the angle of chamfering shall be between 15° and 45° to the axis of the pipe.

The remaining wall thickness of the end of the pipe shall be at least $\frac{1}{3}$ of e_{\min} .

7.2.5 Wall thicknesses

The wall thickness, e , shall conform to Table 4, where the maximum wall thickness at any point of $1,25 e_{\min}$ is permitted provided that the mean wall thickness, e_m , is less than or equal to the specified $e_{m,\max}$.

Table 4 — Wall thicknesses

Dimensions in millimetres

| Nominal size DN/OD | Nominal outside diameter d_n | Wall thickness a,b | | | | | | | | | |
|-----------------------|-----------------------------------|--------------------|-------------|-----------|-------------|-----------|-------------|-----------|-------------|-----------|-------------|
| | | SN 2 | | SN4 | | SN8 | | | | SN 16 | |
| | | S 20 ^c | | S 16 | | S14 | | S 12,5 | | S10,5 | |
| | | SDR 41 | | SDR 33 | | SDR 29 | | SDR 26 | | SDR22 | |
| | | e_{min} | $e_{m,max}$ | e_{min} | $e_{m,max}$ | e_{min} | $e_{m,max}$ | e_{min} | $e_{m,max}$ | e_{min} | $e_{m,max}$ |
| 110 | 110 | - | - | 3,4 | 4,0 | 3,8 | 4,4 | 4,2 | 4,9 | 5,0 | 5,7 |
| 125 | 125 | - | - | 3,9 | 4,5 | 4,3 | 5,0 | 4,8 | 5,5 | 5,7 | 6,5 |
| 160 | 160 | - | - | 4,9 | 5,6 | 5,5 | 6,3 | 6,2 | 7,1 | 7,3 | 8,3 |
| 200 | 200 | - | - | 6,2 | 7,1 | 6,9 | 7,8 | 7,7 | 8,7 | 9,1 | 10,3 |
| 250 | 250 | 6,2 | 7,1 | 7,7 | 8,7 | 8,6 | 9,7 | 9,6 | 10,8 | 11,4 | 12,8 |
| 315 | 315 | 7,7 | 8,7 | 9,7 | 10,9 | 10,8 | 12,1 | 12,1 | 13,6 | 14,4 | 16,1 |
| 355 | 355 | 8,7 | 9,8 | 10,9 | 12,2 | 12,2 | 13,7 | 13,6 | 15,2 | 16,2 | 18,1 |
| 400 | 400 | 9,8 | 11,0 | 12,3 | 13,8 | 13,7 | 15,3 | 15,3 | 17,1 | 18,2 | 20,3 |
| 450 | 450 | 11,0 | 12,3 | 13,8 | 15,4 | 15,4 | 17,2 | 17,2 | 19,2 | 20,5 | 22,8 |
| 500 | 500 | 12,3 | 13,8 | 15,3 | 17,1 | 17,1 | 19,1 | 19,1 | 21,3 | 22,8 | 25,3 |
| 560 | 560 | 13,7 | 15,3 | 17,2 | 18,2 | 19,2 | 21,4 | 21,4 | 23,8 | 25,5 | 28,3 |
| 630 | 630 | 15,4 | 17,2 | 19,3 | 21,5 | 21,6 | 24,0 | 24,1 | 26,8 | 28,7 | 31,8 |
| 710 | 710 | 17,4 | 19,4 | 21,8 | 24,2 | 24,3 | 27,0 | 27,2 | 30,2 | 32,3 | 35,8 |
| 800 | 800 | 19,6 | 21,8 | 24,5 | 27,2 | 27,4 | 30,4 | 30,6 | 33,9 | 36,4 | 40,3 |
| 1 000 | 1 000 | 24,5 | 27,2 | 30,6 | 33,9 | 34,2 | 37,9 | 38,2 | 42,3 | 45,5 | 50,3 |
| 1 200 | 1 200 | 29,4 | 32,6 | 36,7 | 40,6 | 41,1 | 45,5 | 45,9 | 50,7 | 54,6 | 60,3 |
| 1 400 | 1 400 | 34,3 | 38,0 | 42,9 | 47,4 | 47,9 | 52,9 | 53,5 | 59,1 | 63,7 | 70,3 |
| 1 600 | 1 600 | 39,2 | 43,4 | 49,0 | 54,1 | 54,7 | 60,4 | 61,2 | 67,5 | 72,7 | 80,2 |

a The e_{min} values are accordance with ISO 4065.

b The tolerances for wall thickness conform to ISO 11922-1 [5], Grade W.

c S 20 is applicable for application area code "U" only.

7.3 Dimensions of fittings

7.3.1 Outside diameters

The mean outside diameter, d_{em} , of the spigot shall conform to Table 2 or Table 3 as applicable.

7.3.2 Design lengths

The design lengths shall be declared by the manufacturer.

NOTE The design lengths (see the dimensions Z in Figures 7 to 11 and Figures 14 to 19) are intended to assist in the design of moulds and are not intended to be used for quality control purposes. ISO 265-1:1988 [5] can be used as a guideline.

7.3.3 Wall thicknesses

The minimum wall thickness e_{\min} of the body or the spigot of a fitting shall conform to Table 5, except that a reduction of 5 % resulting from core shifting is permitted. In such a case, the average of two opposite wall thicknesses shall be equal to or exceed the values given in Table 5.

Where a fitting or adaptor provides for a transition between two nominal sizes, the wall thickness of each connecting part shall conform to the requirements for the applicable nominal size. In such a case, the wall thickness of the fitting body is permitted to change gradually from the one wall thickness to the other.

The wall thickness of fabricated fittings, except for spigot and socket, may be changed locally by the fabrication process, providing that the minimum wall thickness of the body conforms to e_{\min} , as given in Table 4 or Table 5 as appropriate for the pipe series concerned.

Table 5 — Wall thicknesses

Dimensions in millimetres

| Nominal size DN/OD | Nominal outside diameter, d_n | Minimum wall thickness, e_{\min} ^a | | |
|-----------------------|---------------------------------------|---|--------------------------|---|
| | | SN 2 S 20 ^b SDR 41 | SN 4 S 16,0 SDR 33 | SN 8 S 13,3 ^c SDR 27,6 |
| 110 | 110 | — | 3,4 | 4,0 |
| 125 | 125 | — | 3,9 | 4,6 |
| 160 | 160 | — | 4,9 | 5,8 |
| 200 | 200 | — | 6,2 | 7,3 |
| 250 | 250 | 6,2 | 7,7 | 9,1 |
| 315 | 315 | 7,7 | 9,7 | 11,4 |
| 355 | 355 | 8,7 | 10,9 | 12,9 |
| 400 | 400 | 9,8 | 12,3 | 14,5 |
| 450 | 450 | 11,0 | 13,8 | 16,3 |
| 500 | 500 | 12,3 | 15,3 | 18,1 |
| 560 | 560 | 13,7 | 17,2 | 20,3 |
| 630 | 630 | 15,4 | 19,3 | 22,8 |
| 710 | 710 | 17,4 | 21,8 | 25,7 |
| 800 | 800 | 19,6 | 24,5 | 29,0 |
| 1 000 | 1000 | 24,5 | 30,6 | 36,2 |
| 1 200 | 1200 | 29,4 | 36,7 | 43,4 |
| 1 400 | 1400 | 34,3 | 42,9 | 50,6 |
| 1 600 | 1600 | 39,2 | 49,0 | 57,9 |

^a The e_{\min} values are in accordance with ISO 4065 .

^b S 20 is applicable for application area code "U" only.

^c S 13,3 is only an injection moulded fitting series.

7.4 Dimensions of sockets and spigots

7.4.1 Diameters and lengths of elastomeric ring seal sockets and spigots

The diameters and lengths of elastomeric ring seal sockets and lengths of spigots shall conform to Table 6 (see Figures 2, 3, 4 or 5, as applicable).

Where sealing rings are firmly retained, the dimensions for the minimum value for *A* and the maximum value for *C* shall be measured to the effective sealing point (see Figure 5) as specified by the manufacturer.

This point shall give a full sealing action.

Different designs of elastomeric ring seal sockets and spigots are permitted, provided the joints conform to the requirements given in Table 14.

Table 6 —Socket diameters and lengths of sockets and spigot

Dimensions in millimetres

| Nominal size DN/OD | Nominal outside diameter d_n | Minimum mean inside diameter of the socket $d_{sm,min}^b$ | Socket ^a | | Spigot |
|-----------------------|--------------------------------------|---|---------------------|------------------|-------------|
| | | | A_{min} | C_{max} | $L_{1,min}$ |
| 110 | 110 | 110,4 | 40 | 22 | 62 |
| 125 | 125 | 125,4 | 43 | 26 | 68 |
| 160 | 160 | 160,5 | 50 | 32 | 82 |
| 200 | 200 | 200,6 | 58 | 40 | 98 |
| 250 | 250 | 250,9 | 68 | 50 ^c | 118 |
| 315 | 315 | 316,1 | 81 | 63 ^c | 144 |
| 355 | 355 | 358,3 | 89 | 71 ^c | 160 |
| 400 | 400 | 403,7 | 98 | 80 ^c | 178 |
| 450 | 450 | 454,2 | 108 | 90 ^c | 198 |
| 500 | 500 | 504,6 | 118 | 100 ^c | 218 |
| 560 | 560 | 565,7 | 130 | 112 ^c | 242 |
| 630 | 630 | 635,8 | 144 | 126 ^c | 270 |

^a The socket is designed for an effective length of pipe of 6 m.
^b For nominal sizes DN/OD ≤ 200, $d_{sm,min}$ conforms to EN 1401-1 [6].
^c Higher values for C are allowed for dimensions ≥ DN/OD 250. In that case the manufacturer shall state in his documentation the actual required $L_{1,min}$ according to the equation $L_{1,min} = A_{min} + C$.

For sockets which have a nominal outside diameter greater than 630 mm, the values of $d_{sm,min}$, A_{min} and C_{max} shall be calculated using the following formulae:

$$d_{sm,min} = 1,009 2 d_n; \tag{1}$$

$$A_{min} = (0,2 d_n + 18) \text{ mm}; \tag{2}$$

$$C_{max} = 0,2 d_n. \tag{3}$$

For pipe lengths longer than 6 m the length of engagement A in the socket shall be calculated from the equation: $A = (0,2 d_n + 3 l)$ mm, where l is the pipe length in metres.

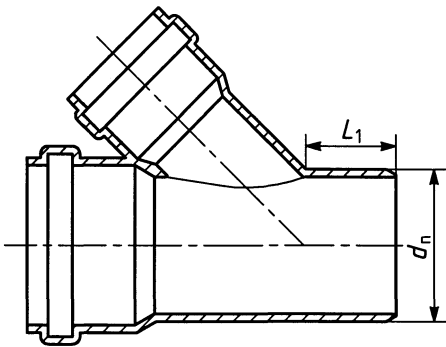


Figure 2 — Spigot length

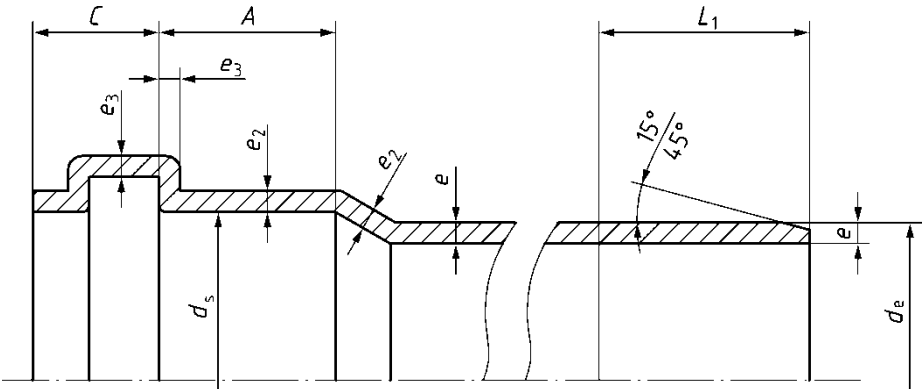


Figure 3 — General dimensions of sockets and spigot ends with elastomeric sealing joints

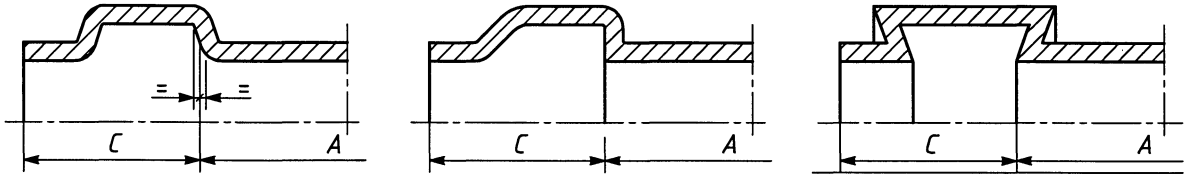


Figure 4 — Typical groove designs for elastomeric ring seal sockets

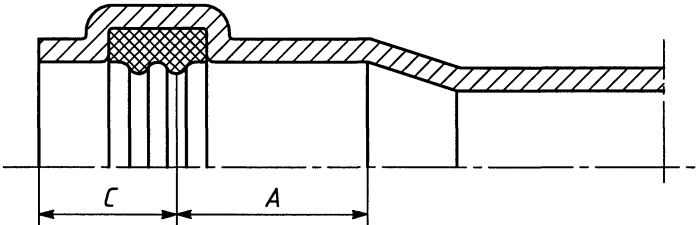


Figure 5 — Example for measuring the effective sealing point

7.4.2 Wall thicknesses of sockets

The wall thicknesses of sockets, e_2 and e_3 (see Figure 3), excluding the socket mouth, shall conform to Table 7, as applicable, except that a reduction of 5 % of e_2 and e_3 resulting from core shifting is permitted. In such a case the average of two opposite wall thicknesses shall be equal to or exceed the values in Table 7.

Where a sealing ring is located by means of a retaining cap or ring (see Figure 6) the wall thickness in this area shall be calculated by addition of the wall thickness of the socket and the wall thickness of the retaining cap or ring at the corresponding places in the same cross section.

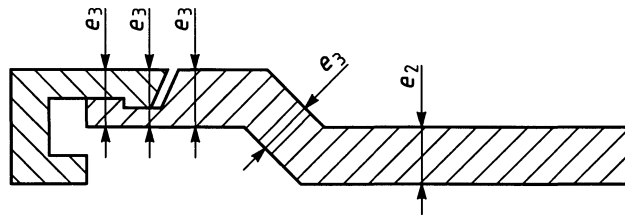


Figure 6 — Example for calculation of the wall thickness of sockets with retaining cap

Table 7 — Wall thicknesses of sockets

Dimensions in millimetres

| Nominal size DN/OD | Nominal outside diameter d_n | Wall thickness | | | | | | | | | | | |
|--------------------|--------------------------------|-------------------|-------------|----------------|----------------|----------------|----------------|---------------------|----------------|-----------------|----------------|----------------|-------------|
| | | SN 2 | | SN 4 | | SN 8 | | | | SN 16 | | | |
| | | S 20 ^a | | S 16 | | S 14 | | S 13,3 ^b | | S 12,5 | | S 10,5 | |
| | | $e_{2,m}$ in | $e_{3,min}$ | $e_{2,m}$ n | $e_{3,m}$ n | $e_{2,m}$ n | $e_{3,m}$ n | $e_{2,m}$ n | $e_{3,m}$ n | $e_{2,m}$ in | $e_{3,m}$ n | $e_{2,m}$ n | $e_{3,min}$ |
| 110 | 110 | – | – | 3,1 | 2,6 | 3,5 | 2,9 | 3,6 | 3,0 | 3,8 | 3,2 | 4,5 | 3,8 |
| 125 | 125 | – | – | 3,6 | 3,0 | 3,9 | 3,3 | 4,2 | 3,5 | 4,4 | 3,6 | 5,2 | 4,3 |
| 160 | 160 | – | – | 4,5 | 3,7 | 5,0 | 4,2 | 5,3 | 4,4 | 5,6 | 4,7 | 6,6 | 5,5 |
| 200 | 200 | – | – | 5,6 | 4,7 | 6,3 | 5,2 | 6,6 | 5,5 | 7,0 | 5,8 | 8,2 | 6,9 |
| 250 | 250 | 5,6 | 4,7 | 7,0 | 5,8 | 7,8 | 6,5 | 8,2 | 6,9 | 8,7 | 7,2 | 10,3 | 8,6 |
| 315 | 315 | 7,0 | 5,8 | 8,8 | 7,3 | 9,7 | 8,1 | 10,3 | 8,6 | 10,9 | 9,1 | 13,0 | 10,8 |
| 355 | 355 | 7,9 | 6,6 | 9,9 | 8,2 | 11,0 | 9,2 | 11,7 | 9,7 | 12,3 | 10,2 | 14,6 | 12,2 |
| ≥ 400 ^c | ≥ 400 | 8,9 | 7,4 | 11,1 | 9,3 | 12,4 | 10,3 | 13,1 | 10,9 | 13,8 | 11,5 | 16,4 | 13,7 |

^a S 20 is applicable for application area code "U" only.

^b S 13,3 is only an injection moulded fitting series

^c At the next revision values for $e_{2,min}$ and $e_{3,min}$ for DN/OD >400 should be added into this table.

7.5 Types of fittings

This standard is applicable for the following types of fittings. Other designs of fittings are permitted.

a) Bends (see Figures 7, 8, 9, 10 and 11):

- 1) unswept and swept angle (see ISO 265-1:1988 [7]);
- 2) spigot/socket and socket/socket;
- 3) butt fused from segments;

NOTE 1 Preferred nominal angles α : 15°; 30°; 45°; 87,5° to 90°.

b) Couplers and slip couplers (see Figures 12 and 13);

c) Reducers (see Figure 14);

d) Branches and reducing branches (see Figures 15, 16, 17 and 18):

- 1) unswept and swept angle;
- 2) spigot/socket and socket/socket.

NOTE 2 Preferred nominal angles α : 45°; 87,5° to 90°.

e) Branches with flange and collar (see Figure 19);

f) Plugs (see Figure 20): minimum length of spigot, $M_{\min} = (C_{\max} + 10)$ mm (see Table 6);

g) Push-fit sockets for butt fusion for pipe end (see Figure 21).

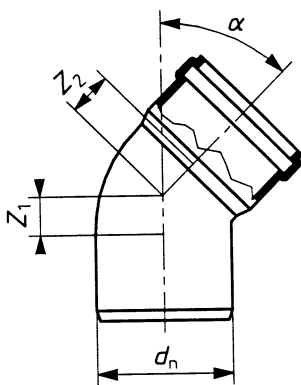


Figure 7 – Bend with single socket (unswept)

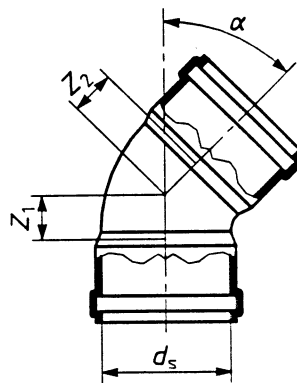


Figure 8 – Bend with all sockets (unswept)

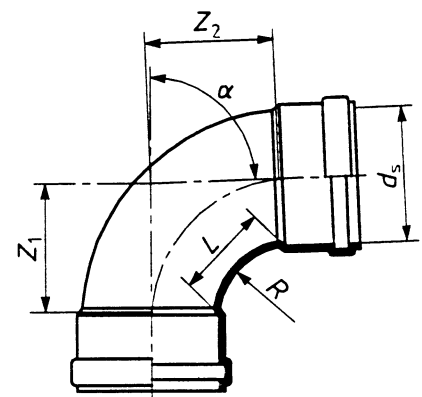


Figure 9 – Bend with all sockets (swept)

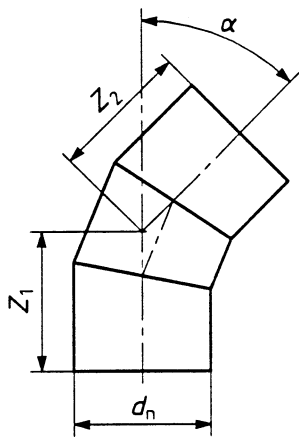


Figure 10 – Bend, butt fused from segments

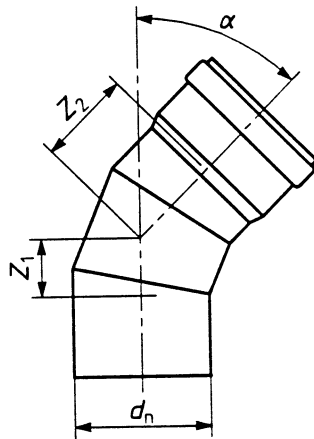


Figure 11 – Bend with socket and spigot end, butt-fused from segments




Figure 12 – Coupler




Figure 13 – Slip coupler

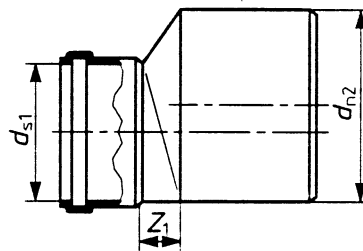


Figure 14 – Reducer

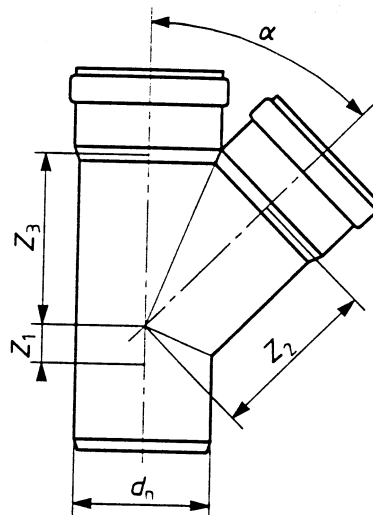


Figure 15 – Branch (unswept)

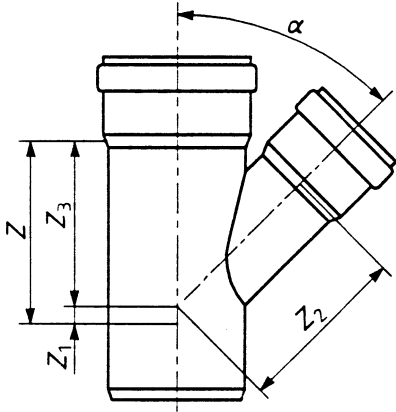


Figure 16 — Reducing branch

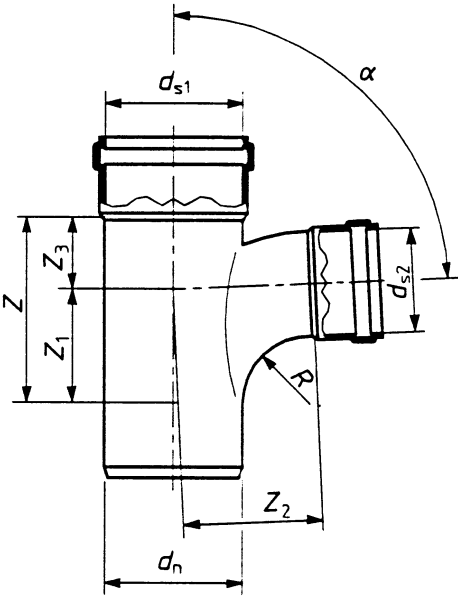


Figure 17 — Reducing branch (swept)

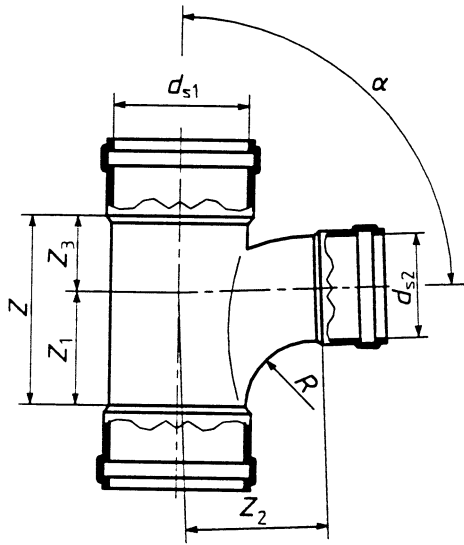


Figure 18 – All socket reducing branch (swept)

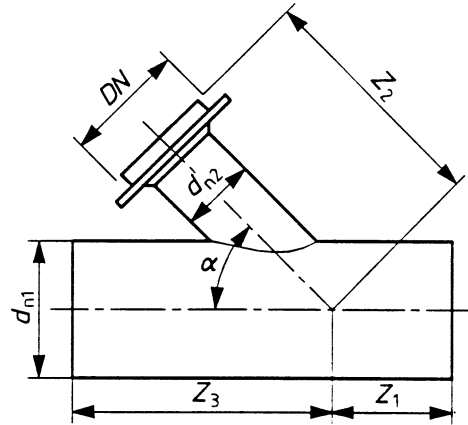


Figure 19 – Branch with flange and collar




Figure 20 – Plug




Figure 21 – Push fit socket for butt fusion for pipe end

8 Mechanical characteristics

8.1 Mechanical characteristics of pipes

8.1.1 General requirements

When tested in accordance with the test method as specified in Table 8 using the indicated parameters, the pipe shall have general mechanical characteristics conforming to the requirements given in Table 8.

Table 8 — General mechanical characteristics of pipes

| Characteristic | Requirements | Test parameters | | Test method |
|--|-------------------------------|-------------------------------|--|-------------|
| Impact resistance ^a (round-the-clock method) | TIR ≤ 10 % | Test/conditioning temperature | 0 °C | EN ISO 3127 |
| | | Conditioning medium | Water or air | |
| | | Type of striker | Shall conform to type d90 of EN ISO 3127 | |
| | | Mass of striker for: | | |
| | | $d_n = 110$ mm | 1,0 kg | |
| | | $d_n = 125$ mm | 1,25 kg | |
| | | $d_n = 160$ mm | 1,6 kg | |
| | | $d_n = 200$ mm | 2,0 kg | |
| | | $d_n = 250$ mm | 2,5 kg | |
| | | $d_n ≥ 315$ mm | 3,2 kg | |
| Fall height of striker for: | | | | |
| $d_n = 110$ mm | 1 600 mm | | | |
| $d_n ≥ 125$ mm | 2 000 mm | | | |
| Ring stiffness ^b | S 20 ≥ 2 kN/m ² | Test temperature | (23 ± 2) °C | EN ISO 9969 |
| | S 16 ≥ 4 kN/m ² | Deflection | 3 % | |
| | S 14 ≥ 8 kN/m ² | Deflection speed for: | | |
| | S12,5 ≥ 8 kN/m ² | $d_i ≤ 100$ mm | (2 ± 0,1) mm/min | |
| | S 10,5 ≥ 16 kN/m ² | 100 mm < $d_i ≤ 200$ mm | (5 ± 0,25) mm/min | |
| | | 200 mm < $d_i ≤ 400$ mm | (10 ± 0,5) mm/min | |
| | | 400 mm < $d_i ≤ 710$ mm | (20 ± 1) mm/min | |
| | | $d_i > 710$ mm | (0,03 × $d_i ± 5$ %) mm/min | |

^a If the manufacturer chooses to use indirect testing (see CEN/TS 1852-2 [8]), the temperature is (23 ± 2) °C.
^b d_i shall be determined in accordance with sub-clause 7.3 of EN ISO 9969:2016.

8.1.2 Additional mechanical requirements

Pipes intended to be used in areas where the installation is carried out at low temperatures, it may be required in the national foreword to conform to the requirements of an impact test (staircase method) as specified in Table 9.

The pipes shall be marked with an ice-crystal symbol in accordance with Table 15.

Table 9 — Additional mechanical characteristics of pipes

| Characteristic | Requirements | Test parameters | | Test method |
|---|--|----------------------------------|------------------------------|--------------|
| Impact resistance (staircase method) | H50 ≥ 1 m max. one break below 0,5 m | Test/conditioning temperature | -10 °C | EN ISO 11173 |
| | | Type of striker | Shall conform to type d90 | |
| | | Mass of striker for: | | |
| | | $d_n = 110$ mm | 4 kg | |
| | | $d_n = 125$ mm | 5 kg | |
| | | $d_n = 160$ mm | 8 kg | |
| | | $d_n = 200$ mm | 10 kg | |
| | | $d_n ≥ 250$ mm | 12,5 kg | |

8.2 Mechanical characteristics of fittings

When tested in accordance with the test methods as specified in Table 10 using the indicated parameters, the fitting shall have mechanical characteristics conforming to the requirements given in Table 10.

Table 10 — Mechanical characteristics of fittings

| Characteristic | Requirements | Test parameters | | Test method |
|---|---|---|---------------------|--------------|
| Flexibility or mechanical strength ^a | No sign of splitting, cracking, separation and/or leakage | EITHER | | |
| | | Test period | 15 min | EN ISO 13264 |
| | | Minimum displacement | 170 mm | |
| | | OR | | |
| Minimum moment for: | | EN ISO 13264 | | |
| | [DN] ≤ 250 | 0,15 × [DN] ³ × 10 ⁻⁶ kNm | | |
| | [DN] > 250 | 0,01 × [DN] kNm | | |
| Impact strength (Drop test) | No damage | Test/conditioning temperature | 0 °C | EN ISO 13263 |
| | | Fall height for: | | |
| | | $d_n = 110$ mm | 1 000 mm | |
| | | $d_n = 125$ mm | 1 000 mm | |
| | | $d_n = 160$ mm | 500 mm | |
| | | $d_n \geq 200$ mm | 500 mm | |
| | | Point of impact | Mouth of the socket | |
| ^a Only for fabricated fittings made from more than one piece. A sealing ring retaining means is not considered as a piece. | | | | |

9 Physical characteristics

9.1 Physical characteristics of pipes

When tested in accordance with the test methods as specified in Table 11 using the indicated parameters, the pipe shall have physical characteristics conforming to the requirements given in Table 11.

Table 11 — Physical characteristics of pipes

| Characteristic | Requirements | Test parameters | | Test method |
|--|---|--|---------|--|
| Longitudinal reversion | ≤ 2 % The pipe shall exhibit no bubbles or cracks | EITHER | | |
| | | Test temperature | 150 °C | Method A: Liquid, in accordance with EN ISO 2505 |
| | | Immersion time | 30 min | |
| | | OR | | |
| Test temperature | 150 °C | Method B: Air in accordance with EN ISO 2505 | | |
| Immersion time for: | | | | |
| $e \leq 8$ mm | 60 min | | | |
| $8 \text{ mm} < e \leq 16$ mm | 120 min | | | |
| $e > 16$ mm | 240 min | | | |
| Melt mass-flow rate (MFR-value) | Permitted max. deviation when processing the compound into pipe: 0,2 g/10 min) ^a | Test temperature | 230 °C | EN ISO 1133-1 |
| | | Reference time | 600 s | |
| | | Nominal load | 2,16 kg | |
| ^a This deviation value should be changed to be specified as a percentage value at the next revision of this standard. | | | | |

9.2 Physical characteristics of fittings

When tested in accordance with the test method as specified in Tables 12 and 13 using the indicated parameters, the fitting shall have physical characteristics conforming to the requirements given in Table 12 and Table 13, as applicable.

Table 12 — Physical characteristics of fittings

| Characteristic | Requirements | Test parameters | | Test method |
|--|--------------|-------------------|--------|---|
| Effects of heating | a, b, c | Temperature | 150 °C | Method A: Air oven, in accordance with EN ISO 580 |
| | | Heating time for: | | |
| | | $e \leq 10$ mm | 30 min | |
| $e > 10$ mm | 60 min | | | |
| ^a The depth of cracks, delamination or blisters shall not be more than 20 % of the wall thickness around the injection point(s). No part of the weld line shall open to a depth of more than 20 % of the wall thickness. ^b Mouldings that shall be used for fabricated fittings, may be tested separately. ^c For fittings manufactured from pipes, the pipes used for such fabricating shall conform to the requirements given in Table 8 and Table 11. | | | | |

Table 13 — Physical characteristics of fabricated fittings

| Characteristic | Requirements | Test parameters | | Test method |
|---|--------------|-----------------|---------|--------------|
| Water tightness | No leakage | Water pressure | 0,5 bar | EN ISO 13254 |
| | | Duration | 1 min | |
| NOTE Only fabricated fittings made from more than one piece. A sealing ring retaining means is not considered as a piece. | | | | |

10 Performance requirements

When tested in accordance with the test methods as specified in Table 14 using the indicated parameters, the joints and the system shall have fitness for purpose characteristics conforming to the requirements given in Table 14.

Table 14 — Fitness for purpose characteristics

| Characteristic | Requirements | Test parameters | | Test method | |
|---|---|-------------------------------|------------------------------|--|----------------|
| Tightness of elastomeric sealing ring joint | | Temperature | (23 ± 5) °C | prEN ISO 13259 | |
| | | Spigot deflection | 10 % | | |
| | | Socket deflection | 5 % | | |
| | No leakage | Water pressure | 0,05 bar | | |
| | | Water pressure | 0,5 bar | | |
| | | Air pressure | -0,3 bar | | |
| | | | Temperature | (23 ± 5) °C | prEN ISO 13259 |
| | | | Angular deflection for: | | |
| | | | $d_n \leq 315$ mm | 2° | |
| | | | 315 mm < $d_n \leq 630$ mm | 1,5° | |
| | | $d_n > 630$ mm | 1° | | |
| No leakage | | Water pressure | 0,05 bar | | |
| No leakage | | Water pressure | 0,5 bar | | |
| ≤ -0,27 bar | Air pressure | -0,3 bar | | | |
| Elevated temperature cycling ^a | No leakage before and after the test; Sagging ≤ 0,05 d_n | Shall conform to EN ISO 13257 | | Test assembly b) (Figure 2 of EN ISO 13257:2017) in accordance with EN ISO 13257 | |
| ^a Test required only for components intended to be used for application area code "D" and for d_n less or equal to 200 mm. | | | | | |

11 Sealing rings

The sealing ring shall have no detrimental effects on the properties of the pipe and the fitting and shall not cause the test assembly to fail to conform to Table 14.

Materials for sealing rings shall conform to all the requirements in EN 681-1 or EN 681-2, as applicable for drainage and sewerage applications.

12 Marking

12.1 General

Marking elements shall be printed or formed directly on the component or be on a label, in such a way that after storage, weathering, handling and installation, the required legibility is maintained.

Two levels of legibility of the marking on components are specified for the individual marking aspects given in Tables 15 and 16. The required durability of marking is coded with decreasing stringency as follows:

A: durable in use;

B: legible until the system is installed.

NOTE The manufacturer is not responsible for marking being illegible, due to actions caused during installation and use such as painting, scratching, covering of the components or by use of detergents, etc. on the components unless agreed or specified by the manufacturer.

Marking shall not initiate cracks or other types of defects which adversely influence the performance of the pipe or the fitting.

Marking by indentation reducing the wall thickness not more than 0,25 mm shall be deemed to conform to this clause without infringing the requirements for the wall thickness given in 7.

The size of the marking shall be such that the marking is legible without magnification.

12.2 Minimum required marking of pipes

Pipes shall be marked at intervals of maximum 2 m, at least once per pipe.

The minimum required marking of pipes shall conform to Table 15.

Table 15 — Minimum required marking of pipes

| Aspects | Marking or symbols | Legibility code |
|---|-------------------------|-----------------|
| - Number of the standard | EN 1852 | A |
| - Application area code | U or UD, as applicable | A |
| - Manufacturer's name and/or trade mark | XXX | A |
| - Nominal size | e.g. 200 | A |
| - Minimum wall thickness or S-series | e.g. either 6,2 or S 16 | A |
| - Material | PP | A |
| - Symbol for close tolerance, when applicable | CT | A |
| - Nominal ring stiffness | e.g. SN 4 | A |
| - Manufacturer's information | a | A |
| - Cold climate performance ^b | * (Ice-crystal) | A |
| - MFR-class ^c | e.g. MFR-B | A |
| <p>^a For providing traceability the following details shall be given: 1) the production period, year and month, in figures or in code; 2) a name or code for the production site if the manufacturer is producing in different sites, nationally and/or internationally.</p> <p>^b This marking is only applicable to pipes which by testing have proved to conform to 8.1.2.</p> <p>^c Only required marking for pipes intended for butt fusion joints.</p> | | |

12.3 Minimum required marking of fittings

The minimum required marking of fittings shall conform to Table 16.

Table 16 — Minimum required marking of fittings

| Aspects | Marking or symbols | Legibility code |
|--|-------------------------|-----------------|
| – Number of the standard | EN 1852 | B |
| – Application area code | U or UD, as applicable | A |
| – Manufacturer’s name and/or trade mark | XXX | A |
| – Nominal size | e.g. 200 | A |
| – Nominal angle | e.g. 45° | B |
| – Minimum wall thickness or S-series | e.g. either 6,2 or S 16 | A |
| – Material | PP | A |
| – Symbol for close tolerance, when applicable | CT | B |
| – Manufacturer’s information | a | B |
| – MFR class ^b | e.g. MFR-B | A |
| ^a For providing traceability the following details shall be given: – the production period, year, in figures or in code; – a name or code for the production site if the manufacturer is producing in different sites, nationally and/or internationally. | | |
| ^b Only required marking for fittings intended for butt fusion joints. | | |

12.4 Additional marking

Pipes and fittings conforming to this standard, which also conform to other standards, may be additionally marked with the required marking of those standards.

Annex A (normative)

Utilization of non-virgin PP material

A.1 Own reprocessed material from pipes and fittings

NOTE For the purpose of this annex, the term pipes refers to extruded pipes and any parts of a fabricated fitting which is made from an extruded pipe. The term fitting means injection-moulded fittings and injection-moulded parts of a fabricated fitting.

The use of clean reprocessed material of components conforming to this standard for the production of pipes and fittings is permitted without limitations.

A.2 External reprocessed and recycled materials with an agreed specification

A.2.1 Material from PP pipes and fittings

External reprocessed and recycled materials with an agreed specification from PP pipes and fittings that are available in relevant quantities and intervals of time may be used alone or added to virgin or own reprocessed or a mixture of those two materials for production of pipes (and fittings, if relevant), provided it originates from products in accordance with an European Standard or national standards replaced by an European Standard and that all of the conditions specified in 5.1, 5.3, 5.4, 5.5 and Tables A.1 and A.2 are met.

Table A.1 — Characteristics of external reprocessed and recycled PP from pipes and fittings that should be included in the agreed specification

| Characteristics | Requirements | | Test method |
|-----------------------------------|--|--|---------------------------------------|
| Density | To be agreed between the manufacturer and supplier | | EN ISO 1183-2 |
| Thermal stability OIT | To be agreed between the manufacturer and supplier | | EN ISO 11357-6 Temperature: 200 °C |
| MFR | To be agreed between the manufacturer and supplier | | EN ISO 1133-1 |
| Ash residue | To be agreed between the manufacturer and supplier | | EN ISO 3451-1 |
| Extraneous polymers | ≤ 5% | | IR analyses or DSC |
| Impurities | Mesh size to be agreed between the manufacturer and supplier | | |
| Type of pigments and/or additives | To be agreed between the manufacturer and supplier | | By analysis |
| Volatile matters | ≤ 300 mg/kg | | EN 12099 |

Table A.2 — Additional specifications for external reprocessed and recycled material from PP products

| | |
|---|--|
| A | Each delivery shall be covered by a declaration according to the agreed specification. This declaration can be made by either the material supplier or the product manufacturer as agreed between the parties. |
| B | The quality plan of the supplier of external reprocessed or recycled material should conform to EN ISO 9001 [9]. |

A.2.2 Material from PP products other than pipes and fittings

External reprocessed and/or recycled material from PP products, other than pipes and fittings, shall not be used for the production of pipes and fittings conforming to this standard.

NOTE This clause may be modified when the new test method(s) from WG28 are available.

Annex B (informative)

General characteristics of PP pipes and fittings

B.1 General

EN 476 [10] specifies the general requirements for components used in discharge pipes, drains and sewers for gravity systems. Pipes and fittings conforming to this standard fully meet these requirements.

Further, the following information is given.

B.2 Material characteristics

The material of pipes and fittings conforming to this standard generally has these characteristics:

Modulus of elasticity of PP materials $1\,250\text{ MPa} \leq E_{(1\text{min})} < 2\,500\text{ MPa}$;

Average density $\approx 0,9\text{ g/cm}^3$;

Average coefficient of linear thermal expansion $\approx 0,14\text{ mm/mK}$;

Thermal conductivity $\approx 0,2\text{ WK}^{-1}\text{m}^{-1}$;

Specific heat capacity $\approx 2\,000\text{ J/kgK}$;

Surface resistance $> 10^{12}\ \Omega$.

Values are dependent on the material used. Therefore, it is recommended to contact the manufacturer, or see the manufacturer's documentation, for the relevant values in each individual case.

B.3 Ring stiffness

The ring stiffness of pipes conforming to this standard is determined in accordance with EN ISO 9969.

When a fitting conforming to this standard has the same wall thickness as the corresponding pipe, the stiffness of this fitting because of its geometry, is equal to or greater than the stiffness of that pipe.

For recommended selection of S-series of fittings and SN-classes of pipes, see CEN/TR 1046 [11].

The actual value of stiffness of the fittings can be determined in accordance with EN ISO 13967 [12].

B.4 Chemical resistance

PP piping systems conforming to this standard are resistant to corrosion by water with a wide range of pH values such as domestic waste water, rainwater, surface water and ground water.

If piping systems conforming to EN 1852 are to be used for chemically contaminated waste waters, such as industrial discharges, chemical and temperature resistance have to be taken into account. For information about the chemical resistance of PP materials guidance is given in ISO/TR 10358:1993 [13] and for rubber materials in ISO/TR 7620:2005 [14].

B.5 Abrasion resistance

Pipes and fittings conforming to this standard are resistant to abrasion. For special circumstances, the abrasion can be determined from the test method given in EN 295-3 [15].

B.6 Hydraulic roughness

Information regarding hydraulic roughness can be found in CEN/TS 15223[16].

B.7 Diametric deflection

In normal installation conditions, the expected average deflection of the outside diameter of the pipes will be less than 8 %. Further information regarding diametric deflection can be found in CEN/TS 15223[16].

Annex C (informative)

Product standards of components that can be connected to components conforming to this standard

EN 1329-1, *Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure — Unplasticized poly(vinyl chloride) (PVC-U) — Part 1: Specifications for pipes, fittings and the system*

EN 1401-1, *Plastics piping systems for non-pressure underground drainage and sewerage — Unplasticized poly(vinyl chloride)(PVC-U) — Part 1: Specifications for pipes, fittings and the system*

EN 1451-1, *Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure — Polypropylene (PP) — Part 1: Specifications for pipes, fittings and the system*

EN 1455-1, *Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure — Acrylonitrile-butadiene-styrene (ABS) — Part 1: Specifications for pipes, fittings and the system*

EN 1519-1, *Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure — Polyethylene (PE) — Part 1: Specifications for pipes, fittings and the system*

EN 1565-1, *Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure — Styrene copolymer blends (SAN+PVC) — Part 1: Specifications for pipes, fittings and the system*

EN 1566-1, *Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure — Chlorinated poly(vinyl chloride) (PVC-C) — Part 1: Specifications for pipes, fittings and the system*

EN 12666-1, *Plastics piping systems for non-pressure underground drainage and sewerage — Polyethylene (PE) — Part 1: Specifications for pipes, fittings and the system*

EN 13476-1, *Plastics piping systems for non-pressure underground drainage and sewerage — Structured-wall piping systems of unplasticized poly(vinyl chloride) (PVC-U), polypropylene (PP) and polyethylene (PE) — Part 1: General requirements and performance characteristics*

EN 13476-2, *Plastics piping systems for non-pressure underground drainage and sewerage — Structured-wall piping systems of unplasticized poly(vinyl chloride) (PVC-U), polypropylene (PP) and polyethylene (PE) — Part 2: Specifications for pipes and fittings with smooth internal and external surface and the system, Type A*

EN 13476-3, *Plastics piping systems for non-pressure underground drainage and sewerage — Structured-wall piping systems of unplasticized poly(vinyl chloride) (PVC-U), polypropylene (PP) and polyethylene (PE) — Part 3: Specifications for pipes and fittings with smooth internal and profiled external surface and the system, Type B*

EN 14758-1, *Plastics piping systems for non-pressure underground drainage and sewerage — Polypropylene with mineral modifiers (PP-MD) — Part 1: Specifications for pipes, fittings and the system*

Bibliography

- [1] EN 13476-2, *Plastics piping systems for non-pressure underground drainage and sewerage — Structured-wall piping systems of unplasticized poly(vinyl chloride) (PVC-U), polypropylene (PP) and polyethylene (PE) — Part 2: Specifications for pipes and fittings with smooth internal and external surface and the system, Type A*
- [2] CEN ISO/TR 27165, *Thermoplastics piping systems — Guidance for definitions of wall constructions for pipes (ISO/TR 27165)*
- [3] EN 14758-1, *Plastics piping systems for non-pressure underground drainage and sewerage — Polypropylene with mineral modifiers (PP-MD) — Part 1: Specifications for pipes, fittings and the system*
- [4] RAL 840-HR, Colour register
- [5] ISO 11922-1:1997, *Thermoplastics pipes for the conveyance of fluids — Dimensions and tolerances — Part 1: Metric series*
- [6] EN 1401-1, *Plastics piping systems for non-pressure underground drainage and sewerage — Unplasticized poly(vinyl chloride) (PVC-U) — Part 1: Specifications for pipes, fittings and the system*
- [7] ISO 265-1:1988, *Pipes and fittings of plastics materials — Fittings for domestic and industrial waste pipes - Basic dimensions: Metric series - Part 1: Unplasticized poly(vinyl chloride) (PVC-U)*
- [8] CEN/TS 1852-2, *Plastics piping systems for non-pressure underground drainage and sewerage — Polypropylene (PP) — Part 2: Guidance for the assessment of conformity*
- [9] EN ISO 9001, *Quality management systems — Requirements (ISO 9001)*
- [10] EN 476, *General requirements for components used in drains and sewers*
- [11] CEN/TR 1046, *Thermoplastics piping and ducting systems — Systems outside building structures for the conveyance of water or sewage — Practices for underground installation*
- [12] EN ISO 13967, *Thermoplastics fittings — Determination of ring stiffness (ISO 13967)*
- [13] ISO/TR 10358:1993, *Plastics pipes and fittings — Combined chemical-resistance classification table*
- [14] ISO/TR 7620:2005, *Rubber materials — Chemical resistance*
- [15] EN 295-3, *Vitrified clay pipe systems for drains and sewers — Part 3: Test methods*
- [16] CEN/TS 15223, *Plastics piping systems — Validated design parameters of buried thermoplastics piping systems*

British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at bsigroup.com/standards or contacting our Customer Services team or Knowledge Centre.

Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at bsigroup.com/shop, where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

Copyright in BSI publications

All the content in BSI publications, including British Standards, is the property of and copyrighted by BSI or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use.

Save for the provisions below, you may not transfer, share or disseminate any portion of the standard to any other person. You may not adapt, distribute, commercially exploit, or publicly display the standard or any portion thereof in any manner whatsoever without BSI's prior written consent.

Storing and using standards

Standards purchased in soft copy format:

- A British Standard purchased in soft copy format is licensed to a sole named user for personal or internal company use only.
- The standard may be stored on more than 1 device provided that it is accessible by the sole named user only and that only 1 copy is accessed at any one time.
- A single paper copy may be printed for personal or internal company use only.
- Standards purchased in hard copy format:
- A British Standard purchased in hard copy format is for personal or internal company use only.
- It may not be further reproduced – in any format – to create an additional copy. This includes scanning of the document.

If you need more than 1 copy of the document, or if you wish to share the document on an internal network, you can save money by choosing a subscription product (see 'Subscriptions').

Reproducing extracts

For permission to reproduce content from BSI publications contact the BSI Copyright & Licensing team.

Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to bsigroup.com/subscriptions.

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

PLUS is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit bsigroup.com/shop.

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email subscriptions@bsigroup.com.

Revisions

Our British Standards and other publications are updated by amendment or revision.

We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

Useful Contacts

Customer Services

Tel: +44 345 086 9001

Email (orders): orders@bsigroup.com

Email (enquiries): cservices@bsigroup.com

Subscriptions

Tel: +44 345 086 9001

Email: subscriptions@bsigroup.com

Knowledge Centre

Tel: +44 20 8996 7004

Email: knowledgecentre@bsigroup.com

Copyright & Licensing

Tel: +44 20 8996 7070

Email: copyright@bsigroup.com

BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK